

PETITION FOR ZONING RECLASSIFICATION AND/OR SPECIAL EXCEPTION

TO THE ZONING COMMISSIONER OF BALTIMORE COUNTY:

Baltimore Gas and Electric Company, legal owner of the property situated in Baltimore County and which is described in the description and plat attached hereto and made a part hereof, hereby petition(s) that the zoning and/or special exception be reclassified as follows:

75-232-X
Case No. 75-232-X

see description attached

and (2) for a Special Exception, under the said Zoning Law and Zoning Regulations of Baltimore County, to use the herein described property, for the construction of two (2) double-circuit 115 kv transmission lines in an R.D.P. zone.

Property is to be posted and advertised as prescribed by Zoning Regulations. I or we, agree to pay expenses of above reclassification and/or Special Exception advertising, posting, etc., upon filing of this petition, and further agree to and are to be bound by the zoning regulations and restrictions of Baltimore County adopted pursuant to the Zoning Law for Baltimore County.

BALTIMORE GAS AND ELECTRIC COMPANY
a body corporate
By *John B. Howard*
John B. Howard, Esquire
409 Washington Avenue
Towson, Maryland 21286
Legal Owner or Agent
Address: Gas and Electric Building
Baltimore, Maryland 21203

Charles A. Herndon, Jr.
Petitioner's Attorneys
Gas and Electric Building
Baltimore, Maryland 21203
Finkbeiner, Attorneys

ORDERED By The Zoning Commissioner of Baltimore County, this 28th day of February, 1975, that the subject matter of this petition be advertised, as required by the Zoning Law of Baltimore County, in two newspapers of general circulation throughout Baltimore County, that property be posted, and that the public hearing be had before the Zoning Commissioner of Baltimore County in Room 106, County Office Building in Towson, Baltimore County, on the 2nd day of April, 1975 at 1:00 o'clock P. M.

Eric DiNenna
Zoning Commissioner of Baltimore County.

(over)

April 4, 1975

John B. Howard, Esquire
Martindale-Towson Building
409 Washington Avenue
Towson, Maryland 21204

RE: Petition for Special Exception E/S and W/S of Dogwood Road, 2265' S of Old Court Road - 2nd Election District Baltimore Gas and Electric Company - Petitioner NO. 75-232-X (Item No. 170)

Dear Mr. Howard:

I have this date passed my Order in the above referenced matter. Copy of said Order is attached.

Very truly yours,
/s/

S. ERIC DINENNA
Zoning Commissioner

SED/arl

Attachments

cc: Charles A. Herndon, Jr., Esquire
Gas and Electric Building
Baltimore, Maryland 21203

PETITION FOR SPECIAL EXCEPTION BEFORE THE ZONING COMMISSIONER OF BALTIMORE COUNTY FOR THE CONSTRUCTION OF TWO DOUBLE-CIRCUIT 115 KV TRANSMISSION LINES IN AN R.D.P. East and West side of Dogwood Road 2265 feet South of Old Court Road, 2nd District

BALTIMORE GAS & ELECTRIC COMPANY Case No. 75-232-X

ORDER TO ENTER APPEARANCE


Mr. Commissioner:

Pursuant to the authority contained in Section 52h.1 of the Baltimore County Charter, I hereby enter my appearance in this proceeding. You are requested to notify me of any hearing date or dates which may be now or hereafter designated therefore, and of the passage of any preliminary or final Order in connection therewith.

Charles E. Kuntz
Charles E. Kuntz, Jr.
Deputy People's Counsel

John W. Herndon III
JOHN W. HERNDON, III
People's Counsel
County Office Building
Towson, Maryland 21204
409-3211

I HEREBY CERTIFY that a copy of the foregoing Order was mailed this 24th day of March, 1975 to John B. Howard, Esquire, 409 Washington Avenue, Towson, Maryland 21204, and Charles A. Herndon, Jr., Esquire, Gas and Electric Building, Baltimore, Maryland 21203, Attorneys for Petitioner.



I WILL NOT ATTEND. JWH.

**Baltimore County, Maryland
Department of Public Works
COUNTY OFFICE BUILDING
TOWSON, MARYLAND 21204**

Bureau of Engineering
ELLSWORTH W. DIVER, P. E. CHIEF

March 31, 1975

Mr. S. Eric DiNenna
Zoning Commissioner
County Office Building
Towson, Maryland 21204

Re: Item #170 (1974-1975)
Property Owner: Baltimore Gas and Electric Company
E and W side of Dogwood Rd., 2265' S. of Old Court Rd.
Existing Zoning: RDP
Proposed Zoning: Special Exception for the construction of two double-circuit 115 kv transmission lines.
No. of Acres: 23.3 District: 2nd

Dear Mr. DiNenna:

The following comments are furnished in regard to the plat submitted to this office for review by the Zoning Advisory Committee in connection with the subject item.

General:

The comments supplied in connection with the Zoning Advisory Committee review of this site for Item #166 (1973-1974) remain valid and applicable to this Item #170 (1974-1975) and are referred to for your consideration.

Very truly yours,

Ellsworth W. Diver
ELLSWORTH W. DIVER, P. E.
Chief, Bureau of Engineering

END:RAM:PH:ras

LI-ME Key Sheet
13 NW 38, 14 NW 38 & 39 Pos. Sheets
15 NW 38 - 41 Pos. Sheets
NW 1, 2 & E Topo
86 Tax Map

Description for Special Exception for Baltimore Gas and Electric Company electrical transmission line right-of-way, lying and being in the 2nd Election District of Baltimore County, State of Maryland, for the proposed erection of two parallel steel pole transmission lines, spaced generally 53' apart on said right-of-way.

Parcel A:
Being all that portion of right-of-way, varying in width, lying within the outlines of the parcel of land which was the subject of a prior hearing on the Special Exception for Granite Substation, No. 74-204-X, said right-of-way being described as follows: Beginning for the same at a point in the 6th or S. 20°36'54"W. - 792.84' line of the description for said Granite Substation, distant 46.54' measured reversely along said 6th line from the end thereof, to the True Meridian of the Topographical Survey of Baltimore City, S. 204°36' W. - 46.54' to the end thereof, thence running for 3 lines now made parallel to and distant 41' measured at right angles from said proposed steel pole transmission lines, N. 58°56'37" E. - 341.85', N. 31°09'23" E. - 200.58' and S. 34°0'16" E. - 245.99' to intersect said 6th line, thence binding thereon S. 204°36' W. - 157.83' to the place of beginning.

Parcel B:
Being all that portion of right-of-way varying in width, the southernmost side being parallel to and distant 41' measured at right angles in a southerly direction from the centerline of the proposed southernmost pole line, thence running for said center line from a point in the 6th or S. 20°36'54" W. - 792.84' line of that description for the parcel of land which was the subject of said prior hearing on the Special Exception for Granite Substation, distant 46.54' measured reversely along said 6th line from the end thereof, said southernmost pole line bearing S. 58°56'37" E. - 1061.18', the northernmost pole line and thence running for said center line from a point in the aforesaid 6th line of the description for Granite, distant 155.46' measured reversely along said 6th line from the end thereof, said northernmost pole line bearing S. 54°09'16" E. - 514.52' and S. 58°56'37" E. - 577.84', thence continuing to run for the center of said northernmost pole line in -

Parcel C:
Being all that portion of right-of-way varying in width, the northernmost side being parallel to and distant 41' measured at right angles from the center line of the proposed northernmost pole line, and the southernmost side being parallel to and varying in distance from 83' to 94' measured at right angles from the centerline of said pole line N. 7°40'17" E. - 1300.77', N. 74°14'23" E. - 715.34', S. 72°09'05" E. crossing Dogwood Road at 110' more or less, for a total distance of 631.59' and S. 68°42'58" E. - 373.00', thence continuing to run for the center of said northernmost pole line in -

Parcel D:
Being all that portion of right-of-way 135' wide, the northernmost and southernmost sides being parallel to and distant 41' and 94' respectively from the center line of the proposed northernmost pole line, S. 40°31'33" E. - 648.29', S. 89°44'36" E. - 865.09' and S. 47°21'30" E. - 637.54', thence continuing to run for the center of said northernmost pole line in -

WILLIAM D. FROMM
DIRECTOR
S. ERIC DINENNA
ZONING COMMISSIONER



March 26, 1975

Mr. S. Eric DiNenna, Zoning Commissioner
Zoning Advisory Committee
Office of Planning and Zoning
Baltimore County Office Building
Towson, Maryland 21204

Dear Mr. DiNenna:

Comments on Item #170, Zoning Advisory Committee Meeting, March 11, 1975, are as follows:

Property Owners: Baltimore Gas and Electric Company
Location: E and W side of Dogwood Road 2265' S of Old Court Road
Existing Zoning: RDP
Proposed Zoning: Special Exception for the construction of two (2) double-circuit 115 kv transmission lines
No. of Acres: 23.3
District: 2nd

This office has reviewed the subject petition and offers the following comments. These comments are not intended to indicate the appropriateness of the zoning in question, but are to assure that all parties are made aware of plans or problems with regard to development plans that may have a bearing on this petition.

This plan has been reviewed and there are no site-planning factors requiring comment.

Very truly yours,

John L. Wimbley
John L. Wimbley
Planning Specialist II
Project and Development Planning

**BOARD OF EDUCATION
OF BALTIMORE COUNTY**

TOWSON, MARYLAND - 21204

Date: March 7, 1975

Mr. S. Eric DiNenna
Zoning Commissioner
Baltimore County Office Building
Towson, Maryland 21204

Z.A.C. Meeting of: March 11, 1975

Re: Item 170
Property Owner: Baltimore Gas & Electric Company
Location: E & W side of Dogwood Rd. 2265' S. of Old Court Rd.
Present Zoning: RDP
Proposed Zoning: Special Exception for the construction of two (2) double-circuit 115 kv transmission lines.

District: 2nd
No. Acres: 23.3

Dear Mr. DiNenna:

No hearing on student population.

WNP/ml

Very truly yours,

W. Nick Petrovich
W. Nick Petrovich,
Field Representative.

Pursuant to the advertisement, posting of property, and public hearing on the above Petition and it appearing that by reason of the requirements of Section 502.1 of the Baltimore County Zoning Regulations having been met, a Special Exception for the construction of two (2) double-circuit 115 kv transmission lines in a R. D. P. Zone.

IT IS ORDERED by the Zoning Commissioner of Baltimore County, this 4th day of April, 1975, that a Special Exception for the construction of two (2) double circuit 115 kv transmission lines in a R.D.P. Zone should be and the same is GRANTED, from and after the date of this Order, subject to the approval of a site plan by the Department of Public Works and the Office of Planning and Zoning.

Michael S. Flanigan
Zoning Commissioner of Baltimore County

Pursuant to the advertisement, posting of property and public hearing on the above petition and it appearing that by reason of the above reclassification should NOT BE HAD, and/or the Special Exception should NOT BE GRANTED.

IT IS ORDERED by the Zoning Commissioner of Baltimore County, this day of 1975, that the above re-classification be and the same is hereby DENIED and that the above described property or area be and the same is hereby continued as to remain a zone; and/or the Special Exception for be and the same is hereby DENIED.

Zoning Commissioner of Baltimore County

BALTIMORE COUNTY, MARYLAND
JEFFERSON BUILDING TOWSON, MARYLAND 21284



DEPARTMENT OF TRAFFIC ENGINEERING

EUGENE J. CLIFFORD, P.E. Wm. T. MELZER
DIRECTOR TRAFFIC ENGINEER

March 21, 1975

Mr. S. Eric DiNenna
Zoning Commissioner
County Office Building
Towson, Maryland - 21204

Re: Item 170 - ZAC - March 11, 1975
Property Owner: Baltimore Gas & Electric Co.
Location: E & W side of Dogwood Rd. 2265' S of Old Court Rd.
Existing Zoning: RDP
Proposed Zoning: SPECIAL EXCEPTION for the construction of two (2) double-circuit 115 kv transmission lines.
No. of Acres: 23.3
District: 2nd

Dear Mr. DiNenna:

No major traffic problems are anticipated by the requested special exception for electric transmission lines.

Very truly yours,

Michael S. Flanigan
Michael S. Flanigan
Traffic Engineering Associate

MSF/bza

BALTIMORE COUNTY, MARYLAND
DEPARTMENT OF HEALTH



JEFFERSON BUILDING
TOWSON, MARYLAND 21284

DONALD J. ROOP, M.D., M.P.H.
DEPUTY STATE AND COUNTY HEALTH OFFICER

March 12, 1975

Mr. S. Eric DiNenna, Zoning Commissioner
Office of Planning and Zoning
County Office Building
Towson, Maryland 21204

Dear Mr. DiNenna:

Comments on Item 170, Zoning Advisory Committee Meeting, March 11, 1975, are as follows:

Property Owner: Baltimore Gas & Electric Co.
Location: E & W side of Dogwood Rd. 2265' S of Old Court Rd.
Existing Zoning: RDP
Proposed Zoning: SPECIAL EXCEPTION for the construction of two (2) double-circuit 115 kv transmission lines.

No. of Acres: 23.3
District: 2nd

Comments: Since this is a special exception for transmission lines, no health hazard is anticipated.

Very truly yours,

Thomas B. Devlin
Thomas B. Devlin, Director
BUREAU OF ENVIRONMENTAL SERVICES

HVB:ce

BALTIMORE COUNTY, MARYLAND

INTER-OFFICE CORRESPONDENCE

TO: S. Eric DiNenna, Zoning Commissioner Date: April 2, 1975

FROM: William D. Frum, Director of Planning

SUBJECT: Petition #75-232-K, East and West side of Dogwood Road 2265 feet South of Old Court Road.
Petition for Special Exception for the Construction of two (2) double-circuit 115 kv Transmission Lines
Petitioner - Baltimore Gas & Electric Company


2nd District

HEARING: Wednesday, April 2, 1975 (1:00 P.M.)

The staff of the Office of Planning and Zoning will offer no comment on this petition at this time.

William D. Frum
William D. Frum
Director of Planning

WDF:MEG:rw



PUBLIC SERVICE COMMISSION
OF MARYLAND
ORDER NO. 60370

IN THE MATTER OF THE APPLICATION OF BALTIMORE GAS AND ELECTRIC COMPANY FOR A CERTIFICATE OF PUBLIC CONVENIENCE AND NECESSITY FOR THE CONSTRUCTION OF TWO DOUBLE CIRCUIT 115 KV TRANSMISSION LINES TO CONNECT THE EXISTING 230 KV TRANSMISSION LINES BETWEEN HOWARD SWITCHING STATION AND NORTHWEST SUBSTATION AT A POINT APPROXIMATELY 2,500 FEET SOUTH OF OLD COURT ROAD IN BALTIMORE COUNTY; AND THENCE IN AN EASTERLY DIRECTION APPROXIMATELY 1.6 MILES TO CONNECT TO THE EXISTING 115 KV TRANSMISSION LINES BETWEEN PUMPKIN SWITCHING STATION AND NORTHWEST SUBSTATION AT A POINT APPROXIMATELY 4,500 FEET SOUTH OF OLD COURT ROAD IN BALTIMORE COUNTY, MARYLAND.

BEFORE THE PUBLIC SERVICE COMMISSION OF MARYLAND
CASE NO. 6635

The Commission after reviewing the record in this case, the Report of its Examiner hearing the matter, and having given due consideration to the need to meet present and future demands for service, effects on system stability and reliability, economics, aesthetics, historic sites, aviation safety and the effect on air and water pollution (no recommendation having been received from the local governing body), is of the opinion and so finds that the construction of the two double circuit 115 kv transmission lines as proposed in this proceeding is in the public interest and that a Certificate of Public Convenience and Necessity should be issued subject to the conditions recommended by the Examiner.

IT IS, THEREFORE, this 2nd day of August, in the year Nineteen Hundred and Seventy-three, by the Public Service Commission of Maryland,

ORDERED: (1) That a Certificate of Public Convenience and Necessity be, and it is hereby, granted to Baltimore Gas and Electric Company for the construction of two double circuit 115 kv transmission lines to connect the existing 230 kv transmission lines between Howard Switching Station and Northwest

PUBLIC SERVICE COMMISSION
OF MARYLAND

Substation at a point approximately 2,300 feet south of Old Court Road in Baltimore County; and thence in an easterly direction approximately 1.6 miles to connect to the existing 115 kv transmission lines between Pumpkin Switching Station and Northwest Substation at a point approximately 4,500 feet south of Old Court Road in Baltimore County, Maryland, as set forth in its application and along the route as shown on Applicant's Exhibits Nos. 2 and 3.

(2) That the following conditions are made a part of the said Certificate of Public Convenience and Necessity:

- (a) That aesthetic type steel poles be used throughout the entire line instead of lattice type towers.
- (b) That the Company follow, where practical, the guidelines for the protection of the natural, historic, scenic and recreational values as set forth in the Guidelines for the Transmission Facilities recommended by the Working Committee on Utilities in its Report to the Vice President and to the President's Council on Recreation and Natural Beauty, dated December 27, 1968.

(c) That the construction of the proposed lines be coordinated with those State and local governmental agencies having requirements which must be met with respect to such construction.

(d) That at any point where the transmission lines cross Brice's Run, streamside vegetation shall be preserved or replaced with suitable trees and shrubs to maintain shading continuity along the creek.

(e) That selective clearing methods be utilized during construction and maintenance of the lines so as to minimize the removal of vegetation.

PUBLIC SERVICE COMMISSION
OF MARYLAND

(3) That Baltimore Gas and Electric Company shall file with this Commission, as promptly as possible, revised estimates for the cost of the project and the annual increase in expenses and taxes as a result of substituting aesthetic type steel poles throughout the lines in lieu of the lattice type steel poles.

ROBERT L. SULLIVAN, JR.

H. REESE SKENOWER, JR.

WILLIAM S. BALDWIN

Commissioners

State of Maryland
Office of Public Service Commission

The preceding copy has been compared with the original

ORDER NO. 60370, CASE NO. 6635 - IN THE MATTER OF THE APPLICATION OF BALTIMORE GAS AND ELECTRIC COMPANY FOR A CERTIFICATE OF PUBLIC CONVENIENCE AND NECESSITY FOR THE CONSTRUCTION OF TWO DOUBLE CIRCUIT 115 KV TRANSMISSION LINES TO CONNECT THE EXISTING 230 KV TRANSMISSION LINES BETWEEN HOWARD SWITCHING STATION AND NORTHWEST SUBSTATION AT A POINT APPROXIMATELY 2,500 FEET SOUTH OF OLD COURT ROAD IN BALTIMORE COUNTY; AND THENCE IN AN EASTERLY DIRECTION APPROXIMATELY 1.6 MILES TO CONNECT TO THE EXISTING 115 KV TRANSMISSION LINES BETWEEN PUMPKIN SWITCHING STATION AND NORTHWEST SUBSTATION AT A POINT APPROXIMATELY 4,500 FEET SOUTH OF OLD COURT ROAD IN BALTIMORE COUNTY, MARYLAND.



on file in this office and I do HEREBY CERTIFY the same to be a correct transcript therefrom and of the whole thereof.

In witness, my hand and the Seal of Office of the Public Service Commission, at the city of Baltimore, this 2nd day of


August one thousand nine hundred

Seventy-three.

Charles C. ...
Secretary.

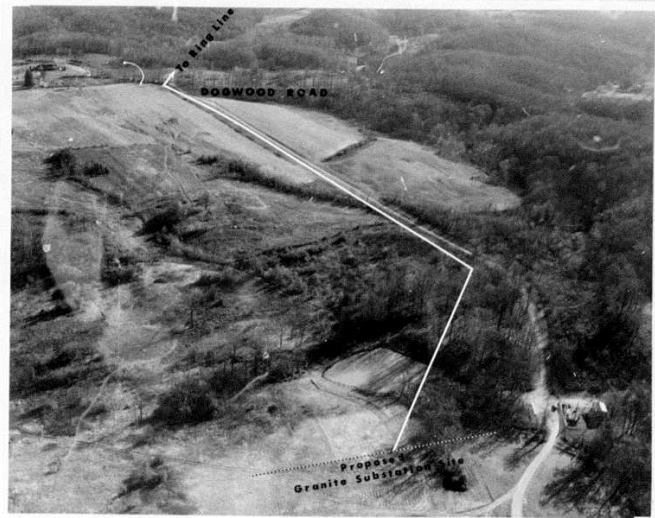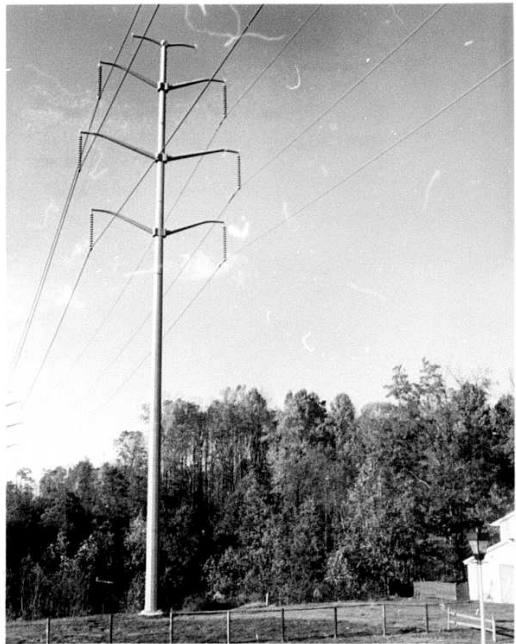


PROPOSED STEEL POLES

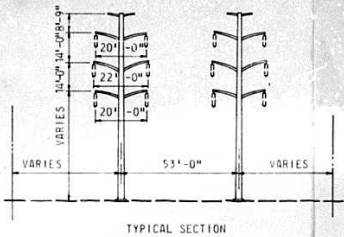

TYPICAL SECTION

ZONED RDP

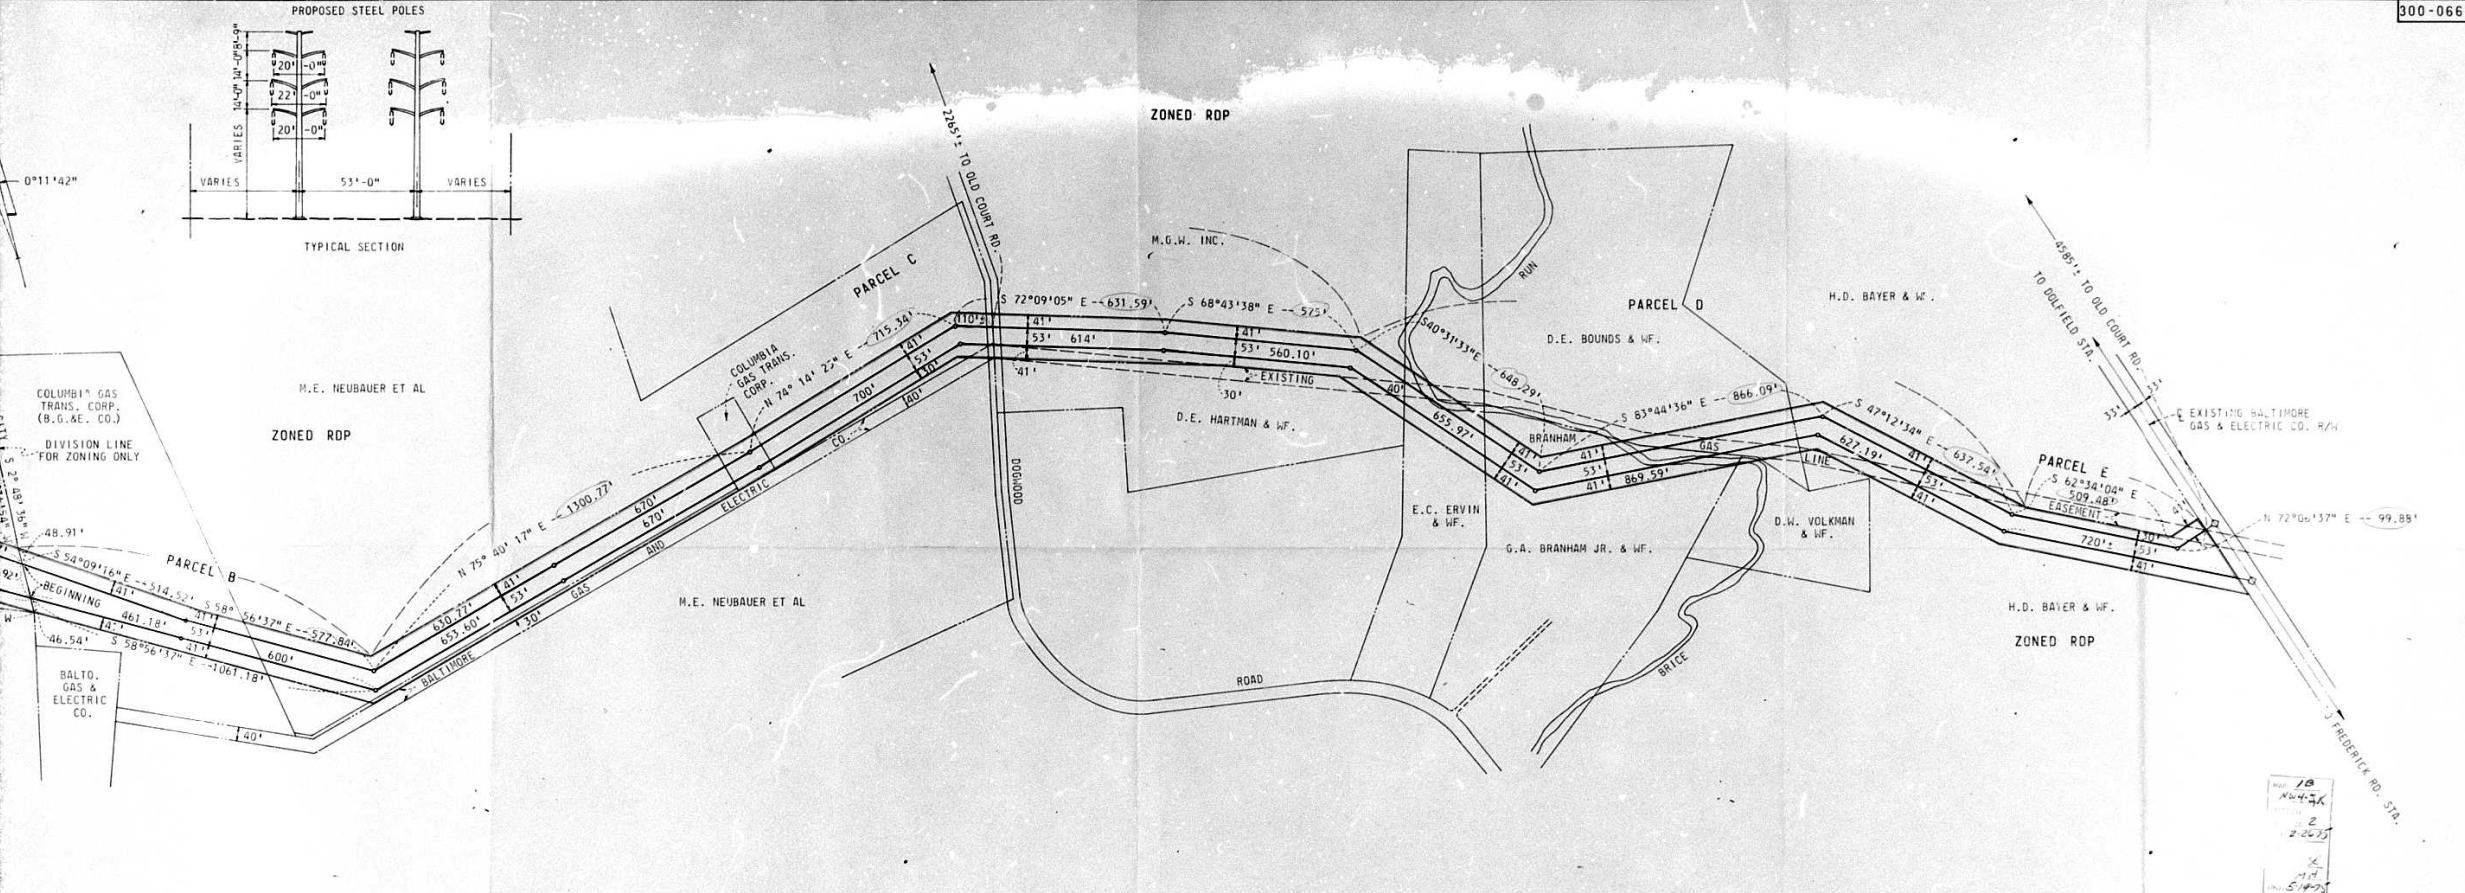

COLUMBIA GAS TRANS. CORP. (B.G. & E. CO.)
 DIVISION LINE FOR ZONING ONLY
 BALTO. GAS & ELECTRIC CO.

M.E. NEUBAUER ET AL
 ZONED RDP

M.E. NEUBAUER ET AL

M.G.W. INC.

D.E. BOUNDS & W.F.
 PARCEL D

H.D. BAYER & W.F.

E.C. ERVIN & W.F.

G.A. BRANHAM JR. & W.F.

D.W. VOLKMAN & W.F.

H.D. BAYER & W.F.

ZONED RDP

NOTE

THIS PLAT BASED ON SURVEY BY DOLLEBERG BROS., TOWSON MD. THE BEARINGS ON THIS PLAT ARE REFERRED TO THE TRUE MERIDIAN OF THE TOPOGRAPHICAL SURVEY OF BALTIMORE CITY.

- INDICATES PROPOSED STEEL POLE
- INDICATES STEEL TOWER




J.F. DOUTHIRT 3RD. (P.L.S. NO. 10)
 ELECTRIC ENGINEERING DEPT.
 BALTIMORE GAS AND ELECTRIC CO.

BALTIMORE GAS AND ELECTRIC COMPANY
 TRANSMISSION LINE RIGHT-OF-WAY
 FROM PROPOSED GRANITE SUBSTATION
 TO EXISTING TRANSMISSION LINE R/W
 IN 2ND ELECTION DISTRICT OF BALTO. CO.
 23.3 ACRES

SCALE: 1"=200'
 DATE: 9-30-74
 DRAWN: C. FLOYD
 APPROVED: J.F.K.



Map No. 18
 No. 4-4K
 2
 2-26-75
 36
 5-14-75
 41

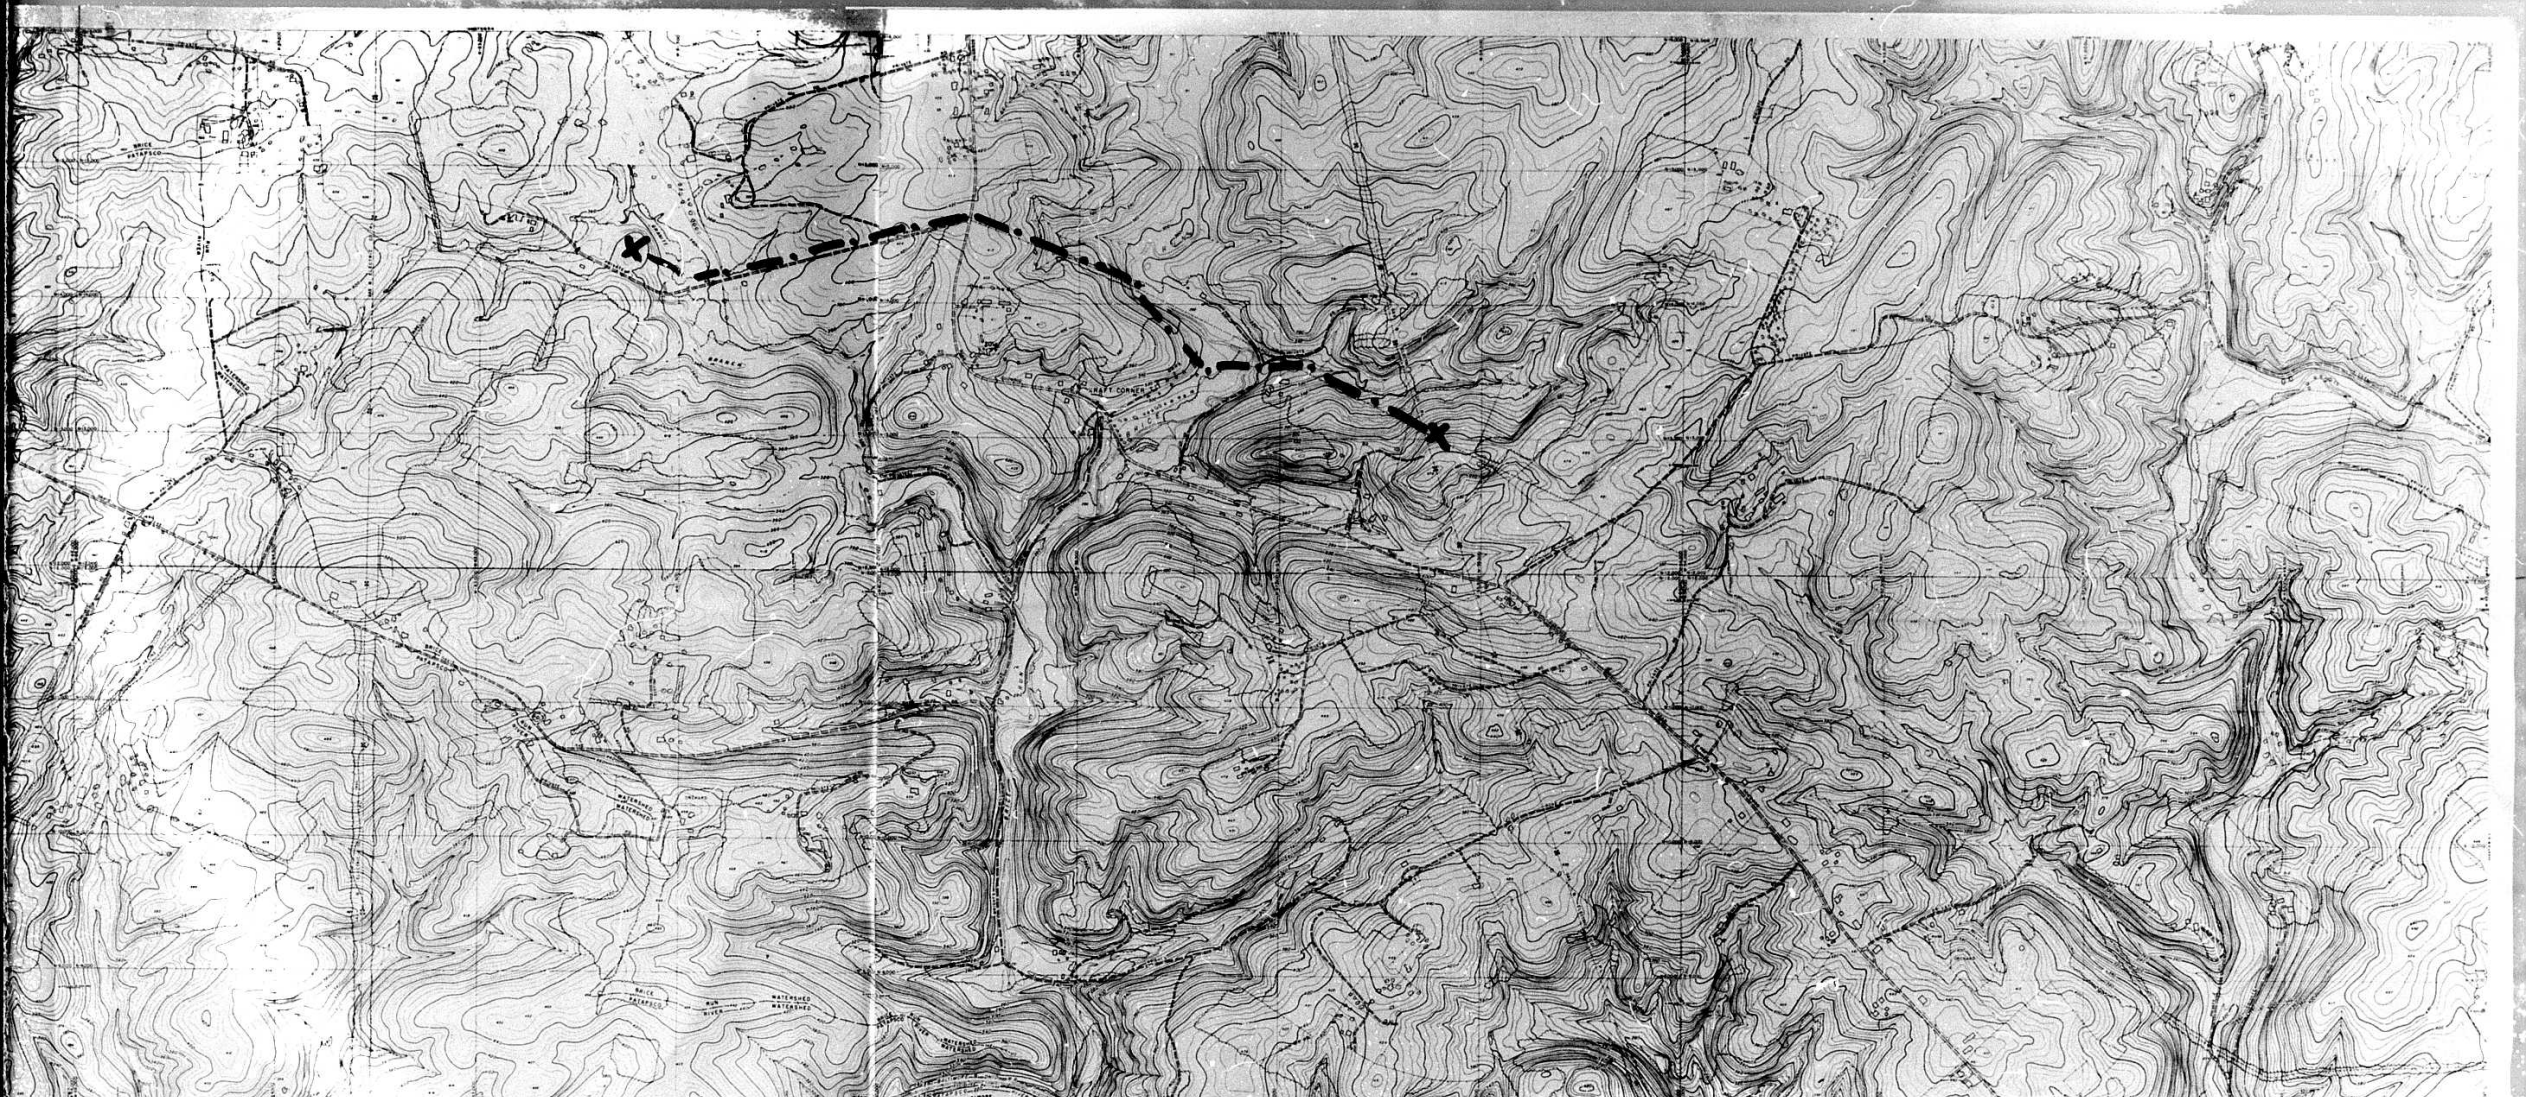

PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND

NEUTRAL SCALE LOCATION
BY DATE OF 1950 NORTH OF
DAVIS TUNNEL


PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND

NEUTRAL SCALE LOCATION SHEET
BY DATE OF 1950 NORTH OF
DANIELS 3-2

PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND

NEUTRAL SCALE LOCATION SHEET
BY DATE OF 1950 NORTH OF
MOLLY FIELD 3-1



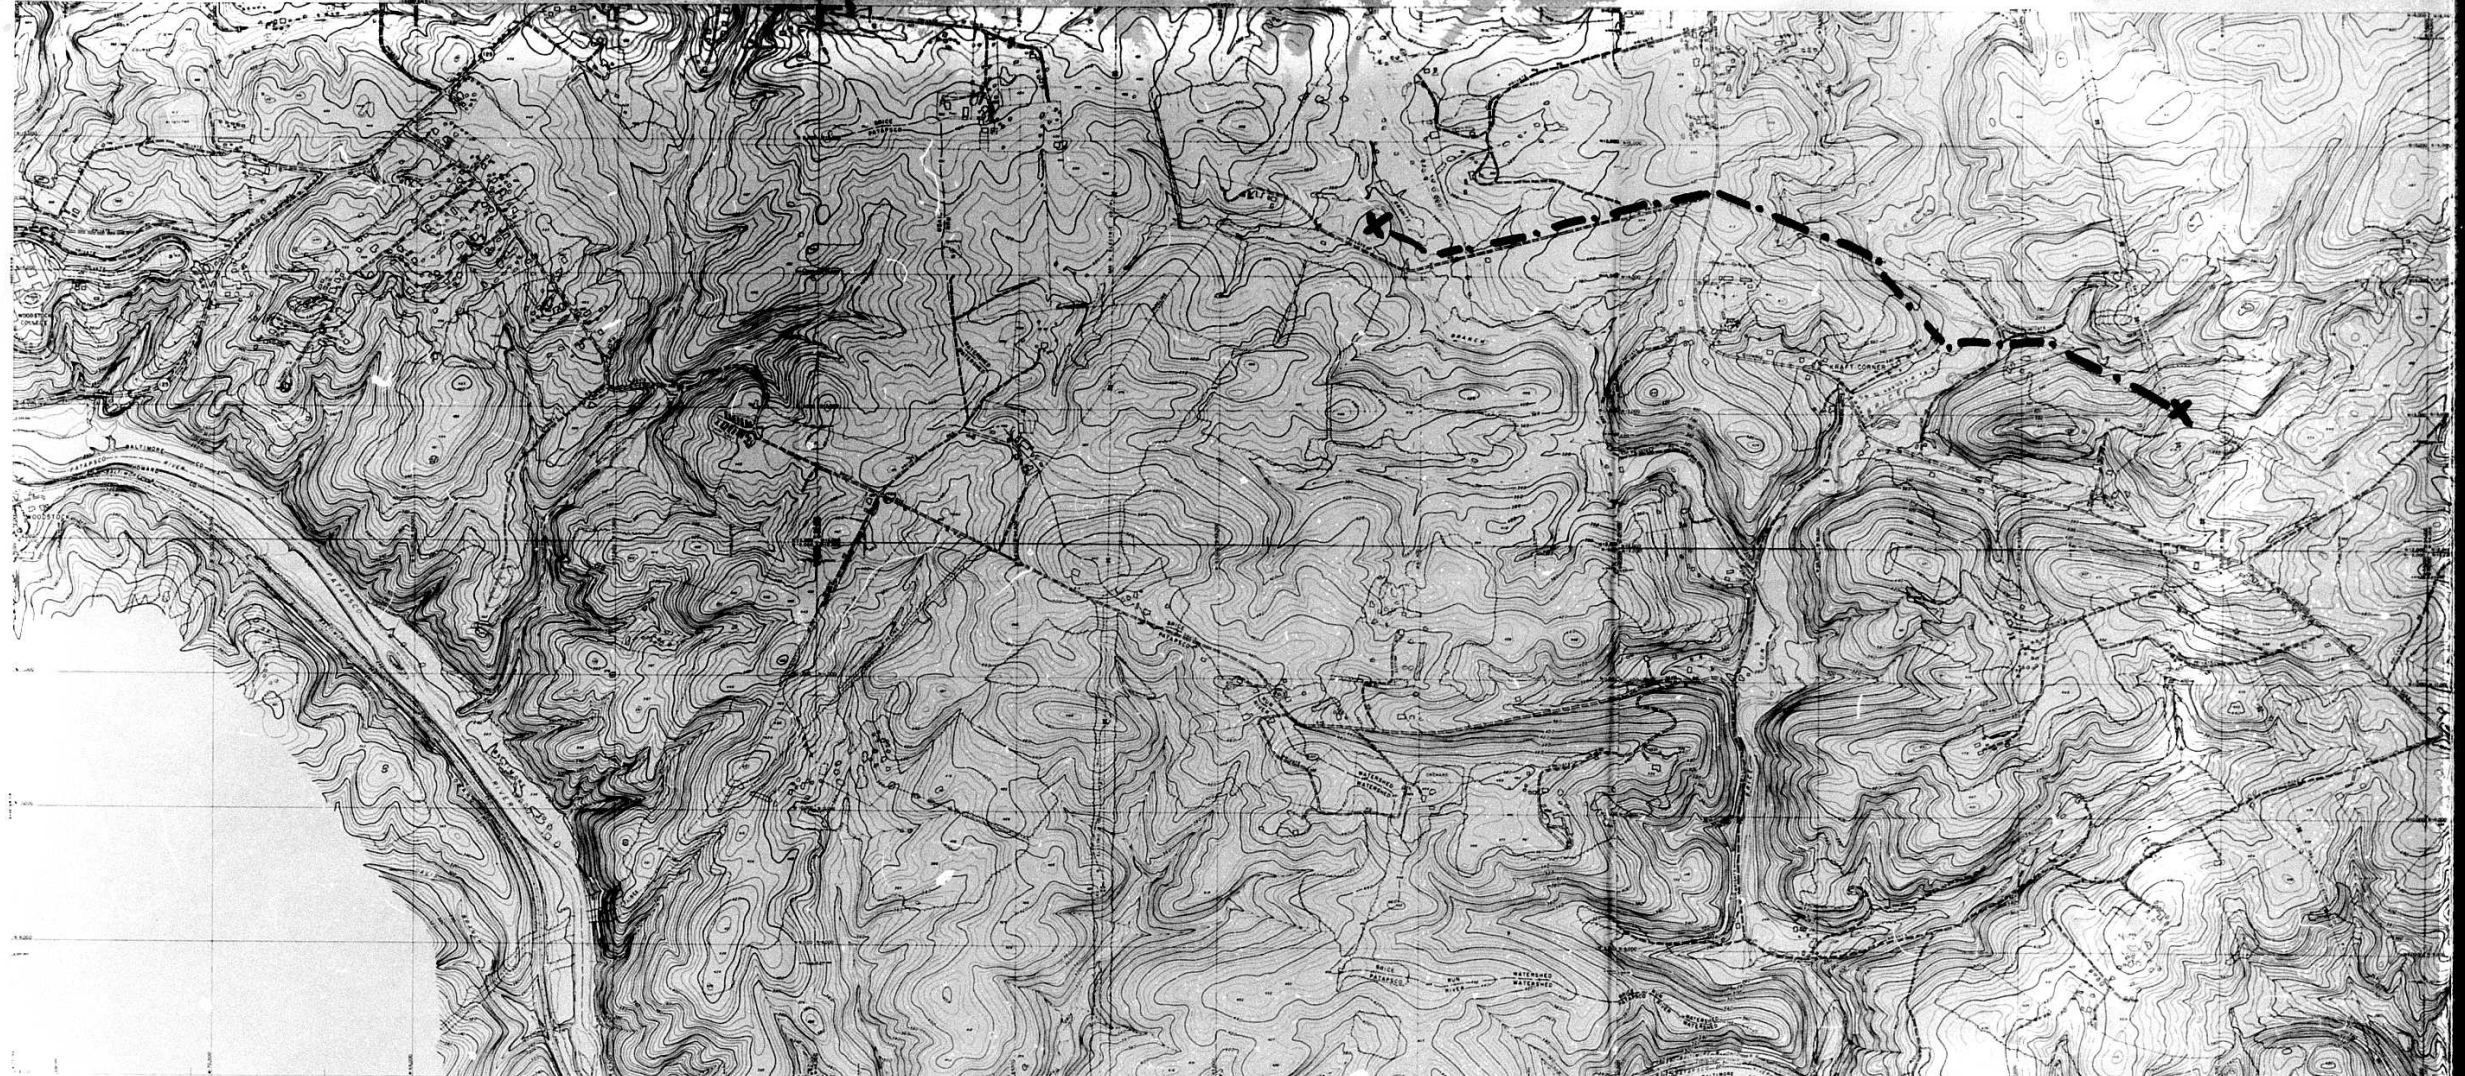

PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND


REVISION	SCALE	LOCATION
	1" = 500'	SOUTH C. WOODSTOCK



PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND

REVISION	SCALE	LOCATION
	1" = 500'	NORTH OF DAVIS TUNNEL

PHOTOGRAMMETRIC MAP OF
BALTIMORE COUNTY, MARYLAND

REVISION	SCALE	LOCATION
	1" = 500'	NORTH OF DANIELS





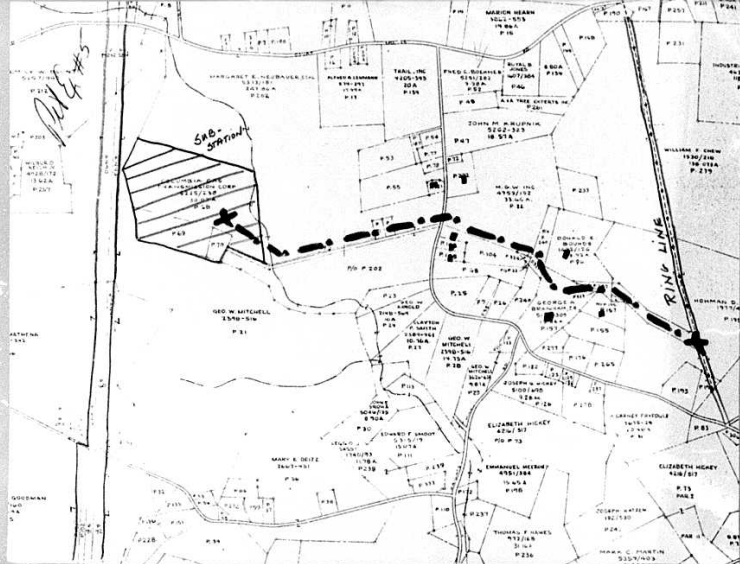


GRANITE
SUBSTATION

PLANS APPROVED
OFFICE OF PLANNING & ZONING
BY: *[Signature]*
DATE: *75-232-x*

FOR CONTINUATION OF
OVERHEAD LINES
SEE DRWG. 216-702-E

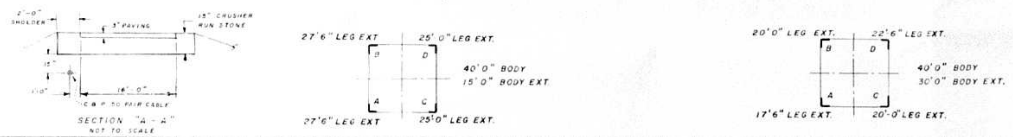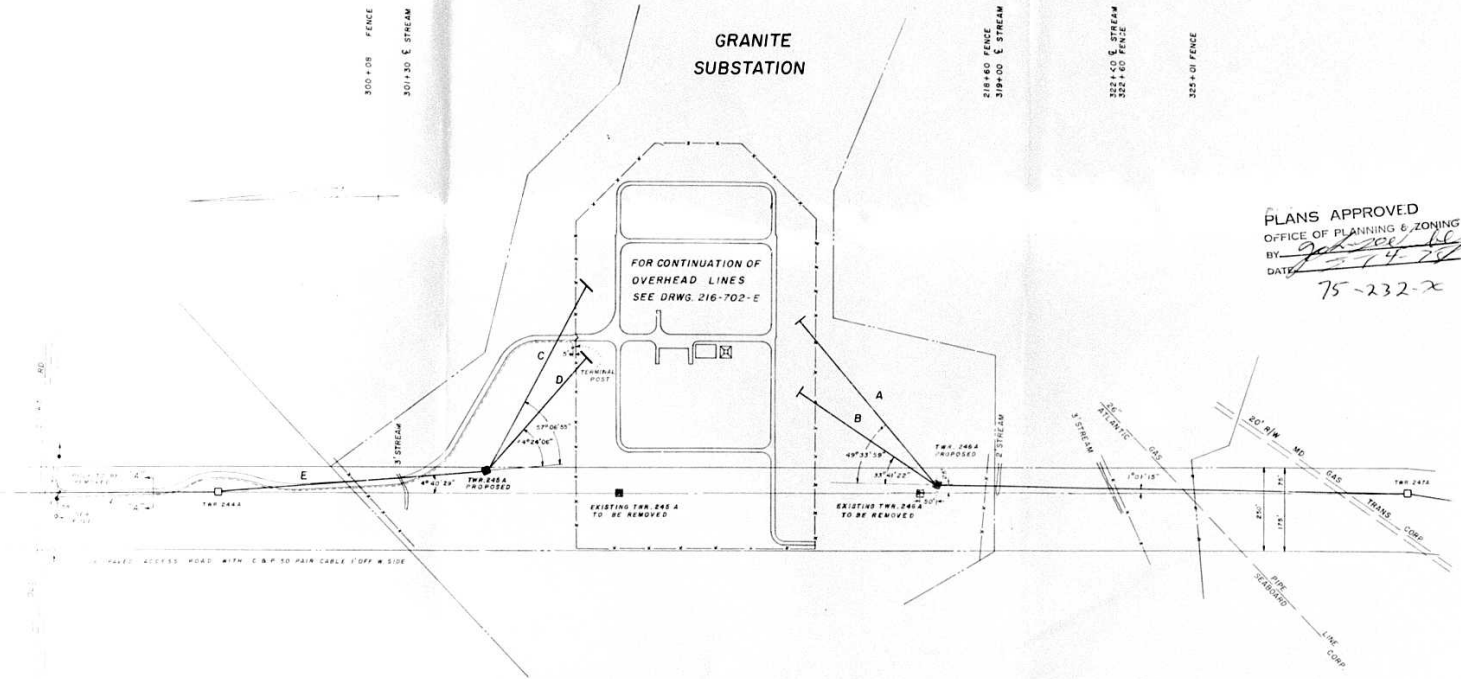

PLAN
SCALE: 1" = 200'
PROFILE
SCALE: HOR. 1" = 200' VERT. 1" = 40'

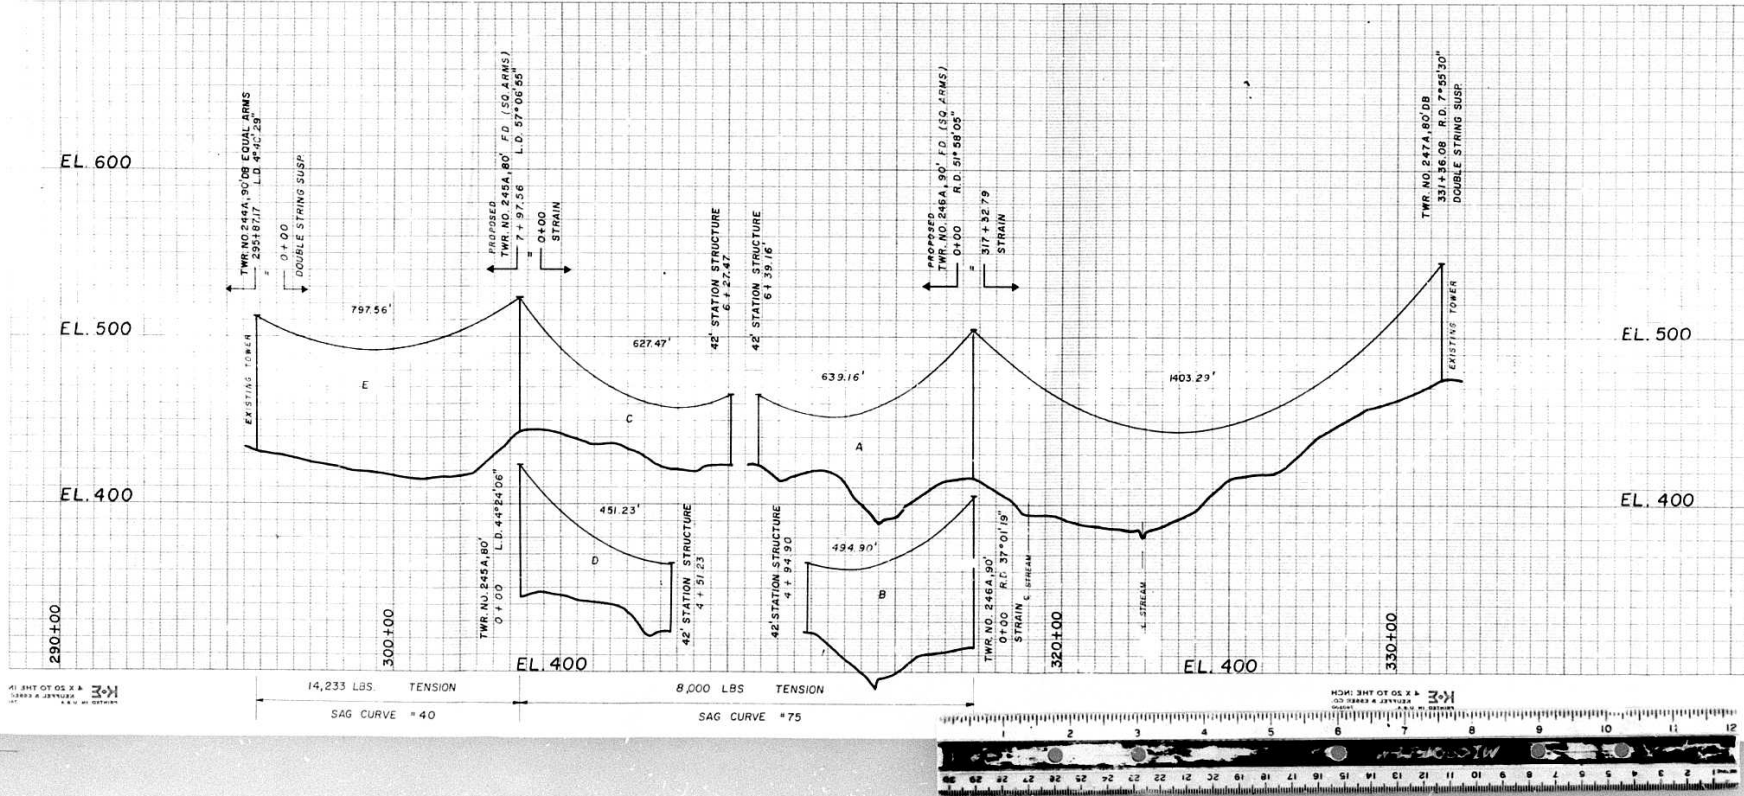

ENGINEERING		REALIGNMENT OF TOWER LINE INTO GRANITE STATION	
Civil	_____	NORTHWEST TO HOWARD	
Elec	_____		
Mech	_____		
Transm	_____		
Chief Eng	_____		
Designer	_____	Baltimore Gas and Electric Company ELECTRIC ENGINEERING DEPARTMENT	
DESIGN & DRAFTING		File	Scale AS NOTED
Drawn	EL HAMMOND	Drawn	300-137-D
Checked	_____	Orig	Rev
Date Appr'd	4/1/77		

7337.42 FT. (1.4 MILES) \pm DIST. (NORTH LINE) FROM TWR. 218 N TO POLE NO. 2081-N
 7449.65 FT. (1.4 MILES) \pm DIST. (SOUTH LINE) FROM TWR. 218 S TO POLE NO. 2081-S

115/230 KV DOUBLE CIRCUIT STEEL POLE LINE
 2,167 KCM 72/7 A.C.S.R. CONDUCTORS, MAXIMUM TENSION 10,000 LBS. (N.E.S.C. HEAVY LOADING)
 3/8 IN. DIA. ALUMOWELD OVERHEAD GROUND WIRES, MAXIMUM TENSION 3,000 LBS. (N.E.S.C. HEAVY LOADING)

SAG CURVE DATA:
 THIS PROFILE REFLECTS SAG AT 257° F
 700' R.S., 33.92 FT. SAG @ 257° F, SAG CURVE NO. 70
 30 FT. MIN. GROUND CLEARANCE AT 257° F



□ C.M. INDICATES CONCRETE MONUMENT

NOTE: LINE INSULATION:
 12 INSULATORS/STRING IN STRAIN
 7 INSULATORS/STRING IN SUSPENSION

PLANS APPROVED
 OFFICE OF PLANNING & ZONING
 BY: *[Signature]*
 DATE: 5-14-75




PLAN
 SCALE 1" = 200'

PROFILE
 SCALE: HOR. 1" = 200' VERT. 1" = 40'

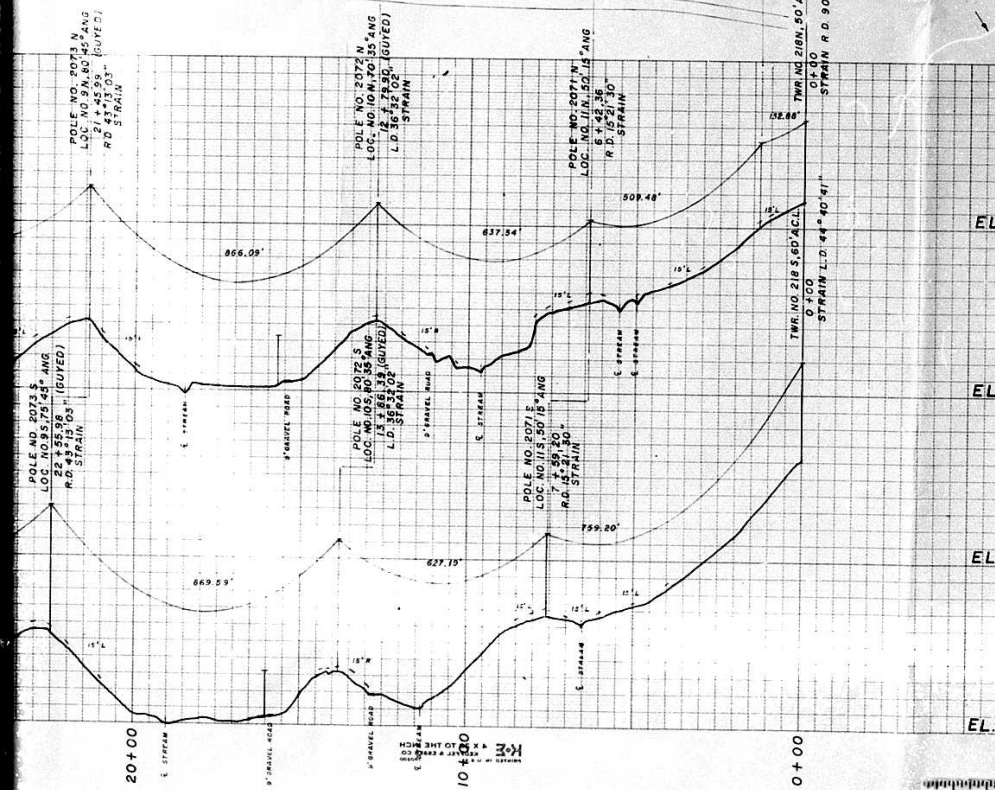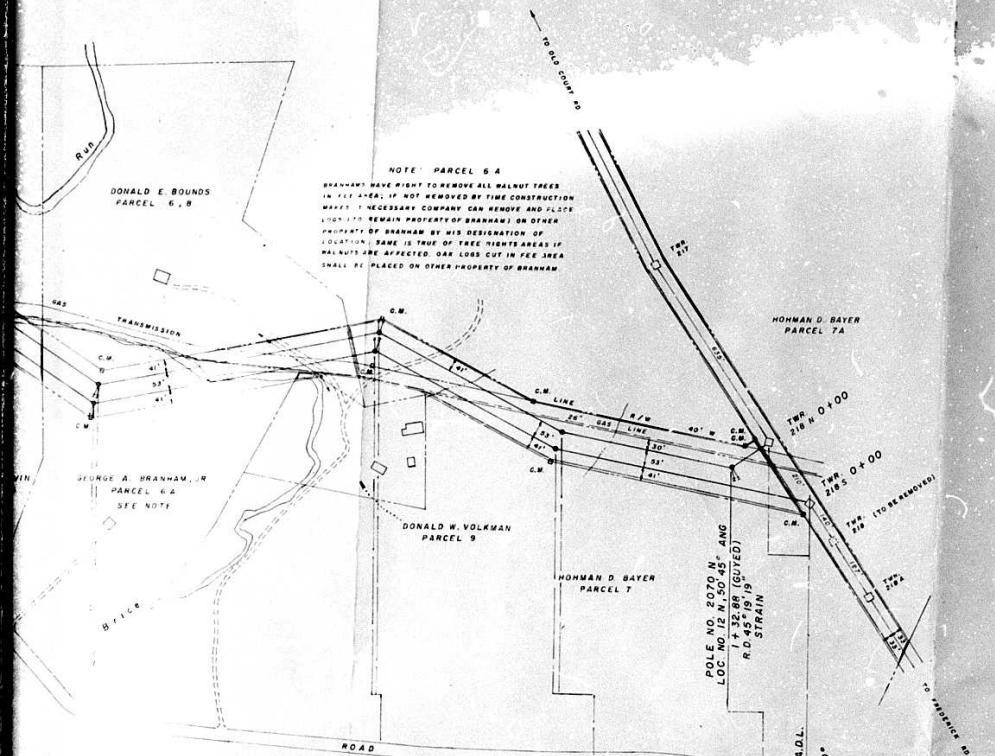

ENGINEERING	115/230 KV DOUBLE CIRCUIT STEEL POLE TRANSMISSION LINE	
Civil		
Elec.		
Mech.		
Transm.		
Chief Eng.	<i>[Signature]</i>	
Manager		
DESIGN & DRAFTING	GRANITE TO RING LINE	
Designed	BALTIMORE GAS AND ELECTRIC COMPANY	
Drawn	ELECTRIC ENGINEERING DEPARTMENT	
Checked		
Date Appr'd	File	Scale AS NOTED
	Microfilm	Rev
	Orig. Rev.	Dwg No.





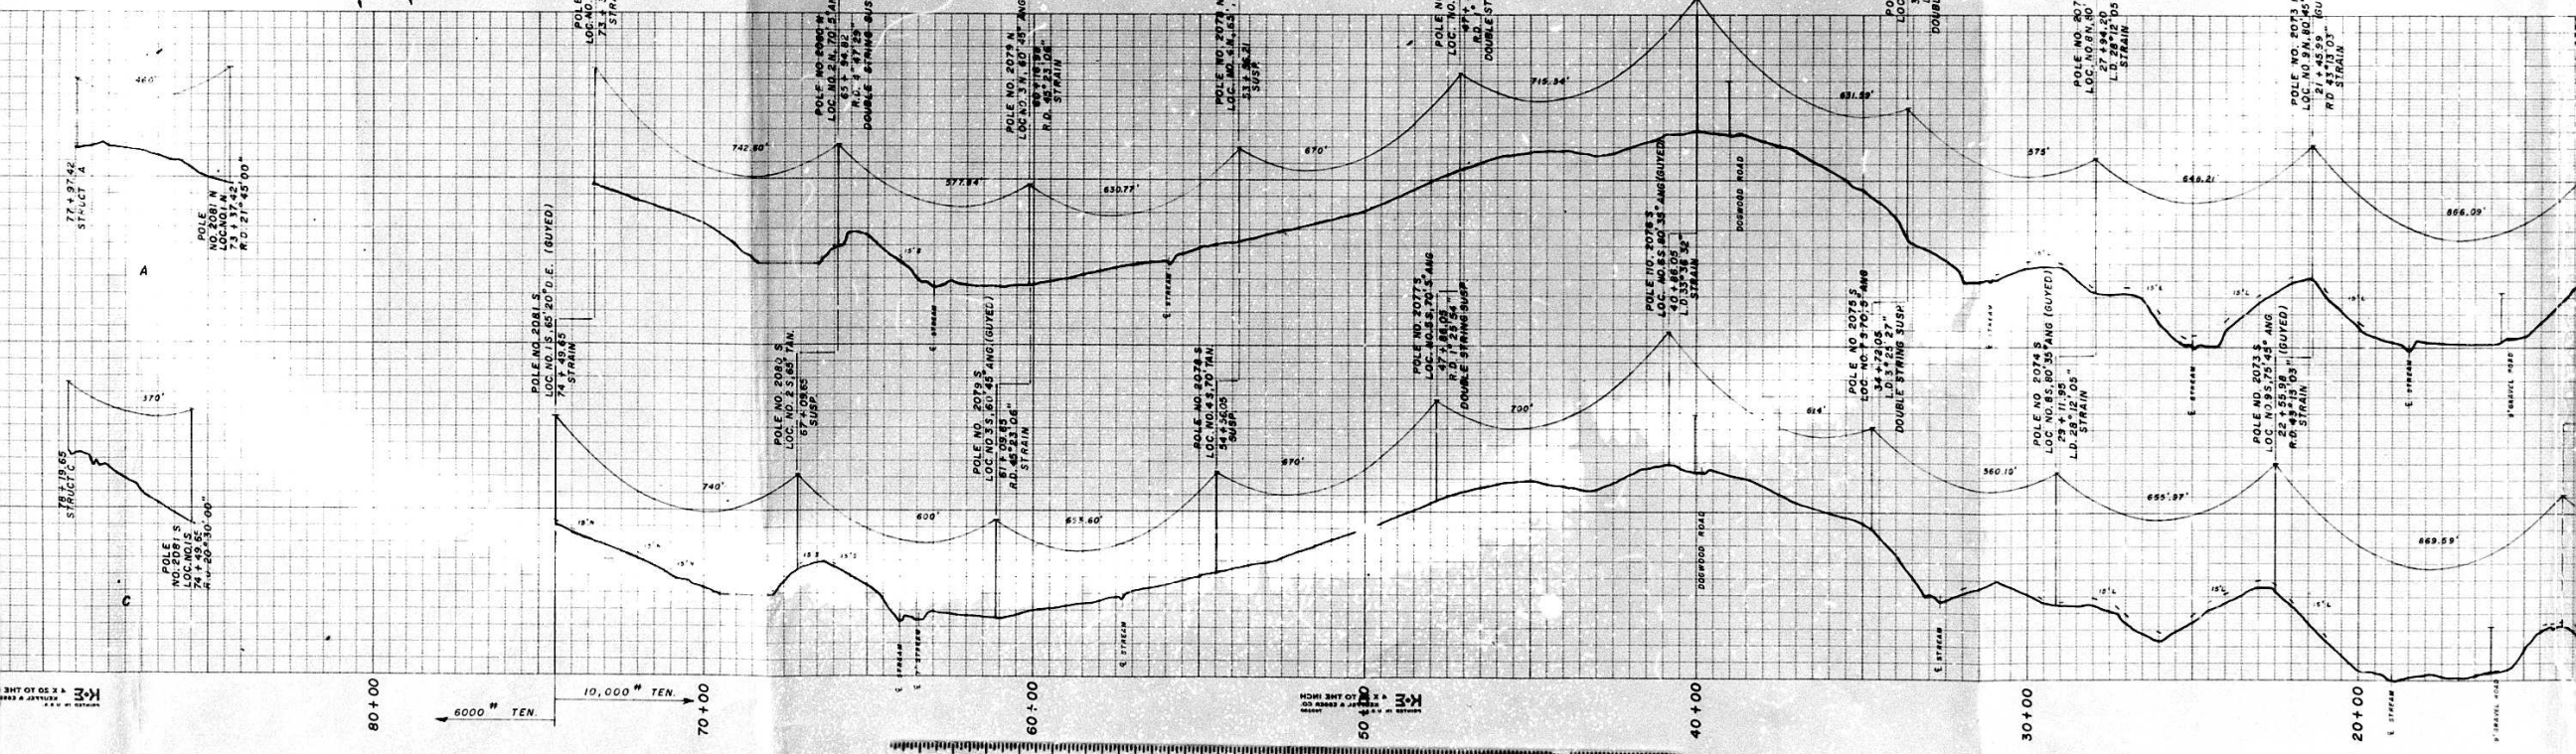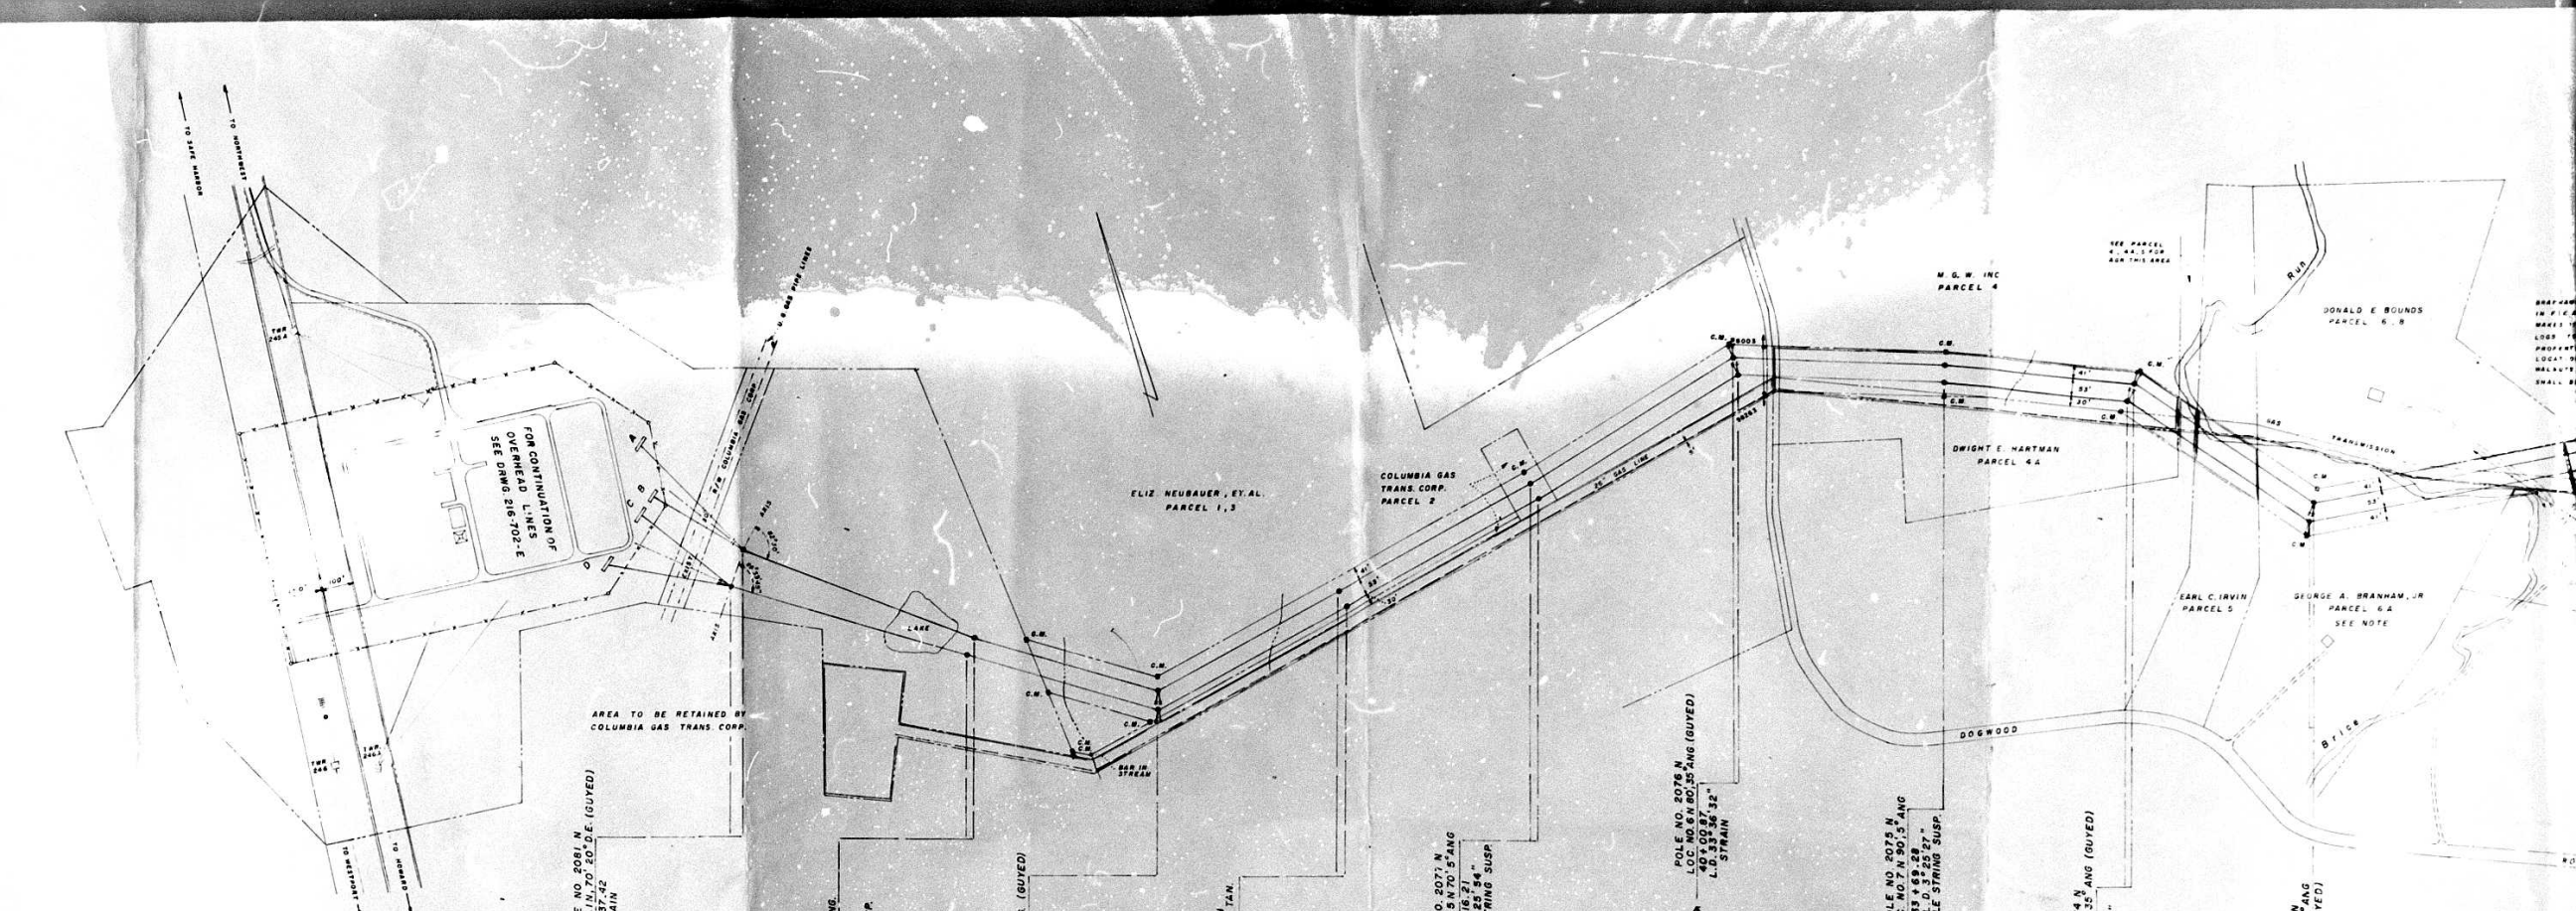

MAY 29 1975

SVUWILE 10-VINC TIVE

K&E
 1/2" = 20' 0" LINE INCH
 1/4" = 10' 0" LINE INCH

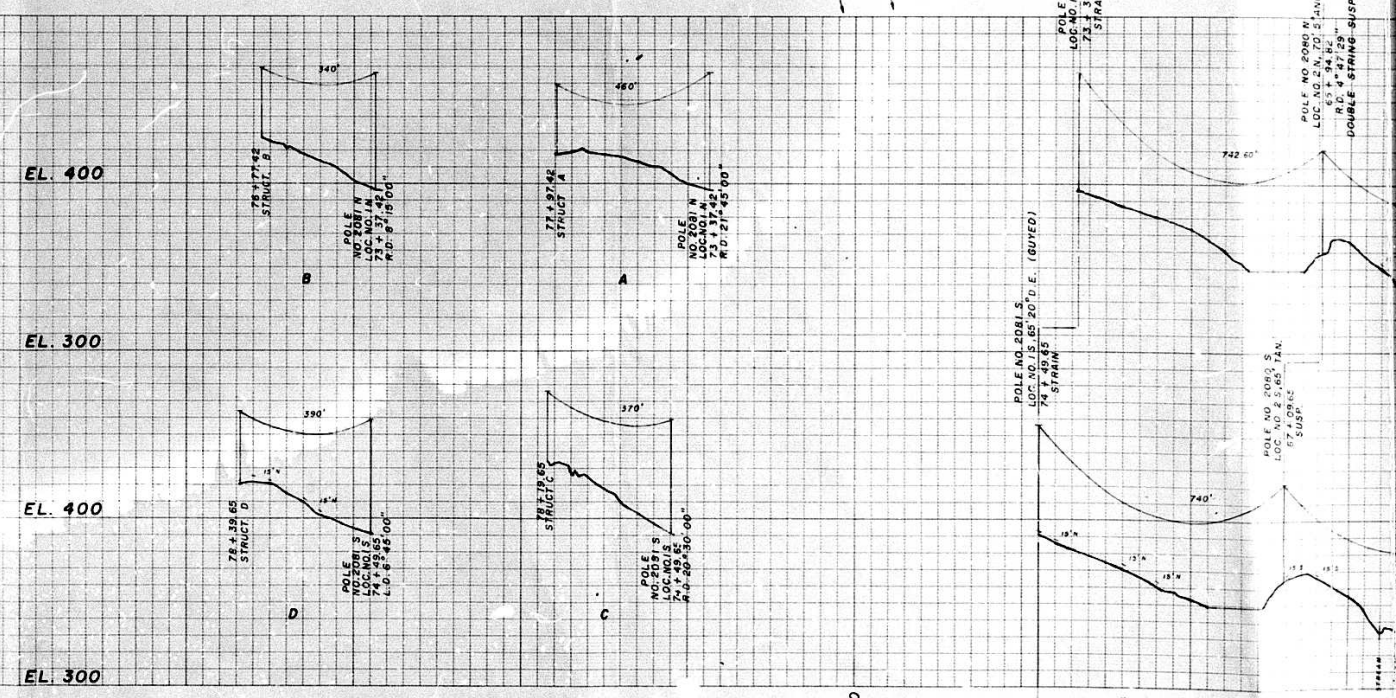

K&E
 1/2" = 20' 0" LINE INCH
 1/4" = 10' 0" LINE INCH

80+00
 6000' TEN.
 10,000' TEN.
 70+00

